



Health

# Certificate of Accreditation

## Sewage Management Facility

### Aerated Wastewater Treatment System

*This Certificate of Accreditation is issued by the Secretary of the NSW Ministry of Health pursuant to Clause 41(1) of the Local Government (General) Regulation 2005.*

*System: Taylex ABS Poly Tank AWTs*

*Manufacturer: Taylex Industries Pty Ltd*

*Of: 56 Prairie Road, Ormeau, QLD, 4208*

*The Taylex ABS Poly AWTs as described in Schedule 1, has been accredited as a sewage management facility for use in single domestic premises in NSW. This accreditation is subject to the conditions and permitted uses specified in Schedule 2.*

*Director, Environmental Health  
for Secretary (delegation PH335)*

*Issued: 14 August 2017*

*Certificate No: AWTs036*

*Expires: 31 December 2020*

## Schedule 1: Specification

### Taylex Poly ABS (Advanced Blower System) AWTS

#### General Description

The Taylex Poly ABS (Advanced Blower System) Aerated Wastewater Treatment System (AWTS) is designed to treat the wastewater from a residential dwelling occupied by a maximum of 10 persons. The Taylex Poly ABS AWTS is contained in one vertical axis type cylindrical polyethylene collection well with a design capacity of 7,108 litres and an operational capacity of 6,066 litres. The operational water level in the primary, second primary, aeration and clarifier chambers of the system is 1,740 mm from the base.

The Taylex Poly ABS system flow path is as follows:

- A primary pre-treatment chamber with a capacity of 1,723 litres;
- A secondary pre-treatment chamber with a capacity of 911 litres;
- An aeration chamber with a capacity of 2,067 litres containing Bio-blok media panels with a surface area of 80m<sup>2</sup>;
- A sedimentation/clarifier chamber with a capacity of 680 litres fitted with a Taylex TFG filter located on the outlet of the clarifier;
- An irrigation pump chamber with a capacity of 685 litres incorporating a capacity of 300 litres for chlorine contact of the effluent;
- A chlorine disinfection unit installed on the outlet pipe of the clarifier;
- Air is supplied to the aeration chamber by an 80 litre/min air blower via a 15 mm PVC pipe to a Taylex fine bubble disk diffuser or equivalent located 300 mm up from the base of the aeration chamber;
- A Davey D25 submersible irrigation pump or equivalent.

## Schedule 2: Conditions of Accreditation

### 1.0 General

- 1.1 For each installation the owner/occupier of the premises shall make an application to the Local Council to install a Taylex Poly ABS AWTS as a waste management facility in accordance with Section 68, Part C of the Local Government Act 1993 and Clause 26 of the Local Government (General) Regulation 2005.
- 1.2 The Taylex Poly ABS AWTS shall be supplied, constructed and installed in accordance with the design as submitted and accredited by the NSW Ministry of Health.
- 1.3 Any modification or variations to the accredited design of the Taylex Poly ABS AWTS shall be submitted for separate consideration and variation of the Certificate of Accreditation by the Director-General of the NSW Ministry of Health.
- 1.4 Each Taylex Poly ABS AWTS shall be permanently and legibly marked on a non-corrosive metal plaque or equivalent, attached to the lid with the following information:
  - The brand name of the system;
  - The manufacturer's name or registered trademark;
  - The month and year of manufacture.
- 1.5 The manufacturer shall supply with each Taylex Poly ABS AWTS an owner's manual, which sets out the care, operation, maintenance and on-going management requirements of the system.
- 1.6 The manufacturer shall provide the following information to each local council where it is intended to install a Taylex Poly ABS AWTS in their area once Ministry accreditation has been obtained:

- Statement of warranty
- Statement of service life
- Quality Assurance Certification
- Installation Manual
- Service Manual
- Owner's Manual
- Service Report Form
- Engineering Drawings on A3 format
- Detailed Specifications
- A4 Plans
- Accreditation documentation from NSW Health.

## **2.0 Installation and Commissioning**

- 2.1 On completion of the installation of the Taylex Poly ABS AWTS, the local council should require that the system is inspected and checked by the manufacturer or the manufacturer's agent. The manufacturer or the agent is to certify that the system has been installed and commissioned in accordance with its design, conditions of accreditation and any additional requirements of the local council.
- 2.2 The local council should require that all electrical work must be carried out by a licensed electrician and in accordance with the relevant provisions of AS/NZS 3000.

## **3.0 Maintenance**

- 3.1 The local council shall require the owner/occupier of the premises to enter into an annual service contract with a representative of Taylex Industries Pty Ltd or a service contractor or company acceptable to the local council.
- 3.2 The Taylex Poly ABS AWTS shall be serviced at three monthly intervals in accordance with the details set out in the owner's and service manuals.
- 3.3 Each three monthly service shall include a check on all mechanical, electrical and functioning parts of the system including:
- The chlorinator and replenishment of the disinfectant,
  - Pumps, air blower, fan or air venturi,
  - The alarm system,
  - Slime growth on the filter media,
  - Operation of the sludge return system,
  - The effluent irrigation area,
  - On-site testing for free residual chlorine, pH and dissolved oxygen.
- 3.4 The local council should require that a service report sheet, in triplicate, is completed for each service. The original shall be given to the owner, the duplicate forwarded to the local council and the triplicate retained by the service contractor.

## **4.0 On-going Management**

- 4.1 The owner's manual prepared by the manufacturer shall contain a plan for the on-going management of the Taylex Poly ABS AWTS. The plan shall include details of:
- the treatment process,
  - procedures to be followed in the event of a system failure,
  - emergency contact numbers,
  - maintenance requirements,
  - inspection and sampling procedures to be followed as part of the on-going monitoring program developed by the local authority.
- 4.2 Effluent from the Taylex Poly ABS AWTS taken in any random grab sample shall comply with the following standard:
- |                          |   |
|--------------------------|---|
| • BOD <sup>5</sup>       | less than 30 mg/L                       |
| • TSS                    | less than 45 mg/L                       |
| • Faecal coliforms       | less than 100 cfu/100 ml                |
| • Free residual chlorine | greater than 0.2 and less than 2.0 mg/L |

## **5.0 Permitted uses**

5.1 The treated effluent from the Taylex Poly ABS AWTS is suitable for re-use for garden purposes using any of the forms of irrigation as described in AS/NZS 1547:2012:

- above ground spray irrigation; or
- surface drip irrigation covered by mulch; or
- sub-surface drip irrigation installed at around 100 mm depth.


Each of the three forms of irrigation is subject to the approval of the local council.

## **6.0 Reduction in nutrient levels**

During the testing of the Taylex Poly ABS AWTS the treated effluent was tested for total N (TN) and total P (TP) concentrations.

The treatment process has the capacity to reduce the above concentrations as follows:

- Total N from an average 53.79 mg/l to 24.9 mg/l which represent a reduction by 53.7%;
- Total P from an average 16.24 mg/l to 2.49 mg/l which represent a reduction by 84.7%

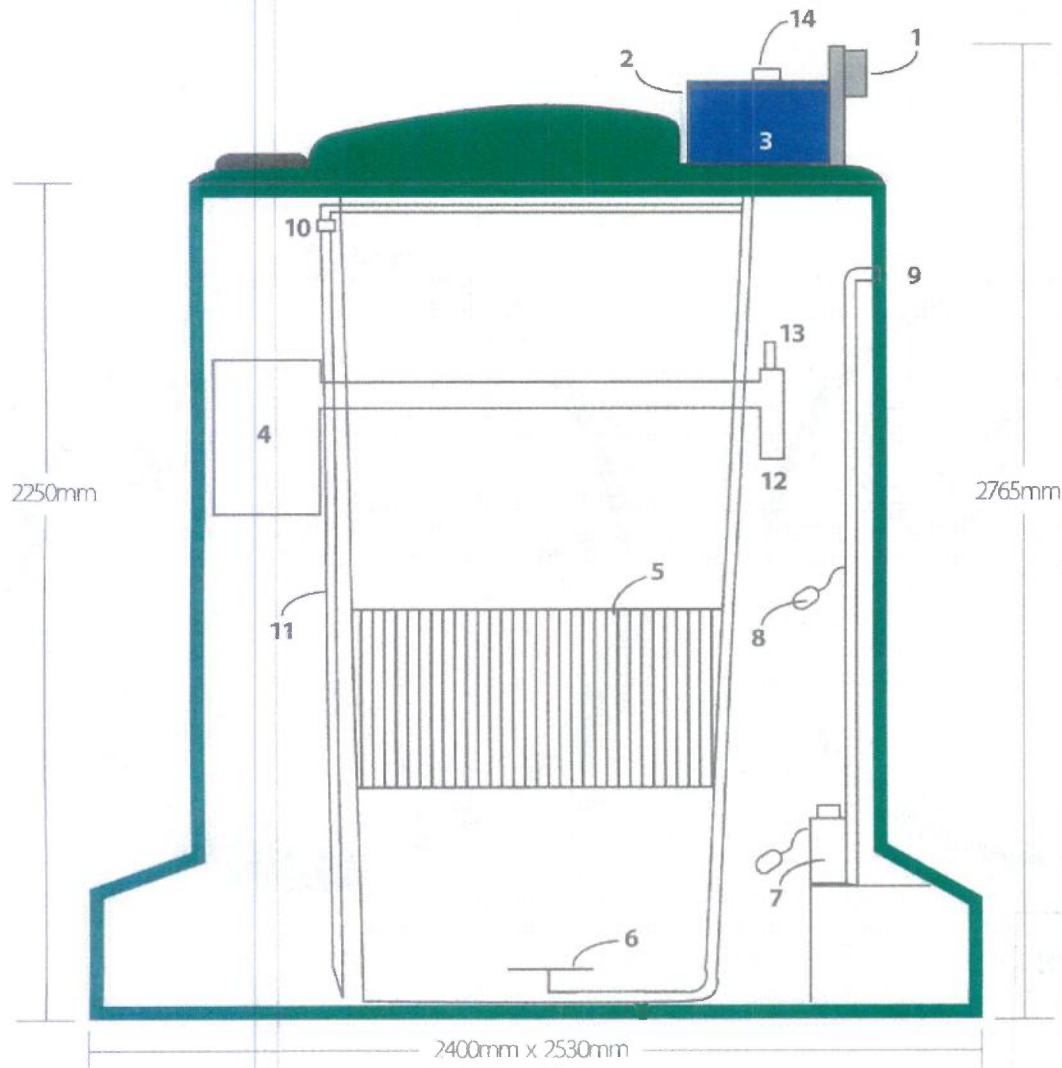

- 1 Taylex ABS Control Panel
- 2 Taylex Blower Box
- 3 80Lt Nitto Blower
- 4 Taylex TFG Filter
- 5 Bio MASS
- 6 Disk Diffuser
- 7 Davey D25 or D 42 Irrigation Pump
- 8 High Level Alarm
- 9 Irrigation Outlet
- 10 Sludge Return Valve
- 11 Sludge Return Pipe
- 12 Chlorine Tee
- 13 Chlorine Tube
- 14 Identification Tag

**APPROVED**  
 14 AUG 2017  
 NSW MINISTRY OF HEALTH

SYSTEM WORKING VOLUMES	
Primary Chamber	1723Lt
Secondary Chamber	911Lt
Aeration Chamber	2067Lt
Clarifier Chamber	680Lt
Irrigation Chamber	685Lt
<b>Total</b>	<b>6066Lt</b>
Emergency Storage	1042Lt



**Taylex**  
Tanks

TAYLEX INDUSTRIES 56 PRAIRIE RD ORMEAU 4221

Taylex Poly ABS

DATE MAY 2012



DRAWN BY  
DARYL WILLISHER

# Taylex Plastic ABS

APPROVED

14 AUG 2017

NSW MINISTRY OF HEALTH

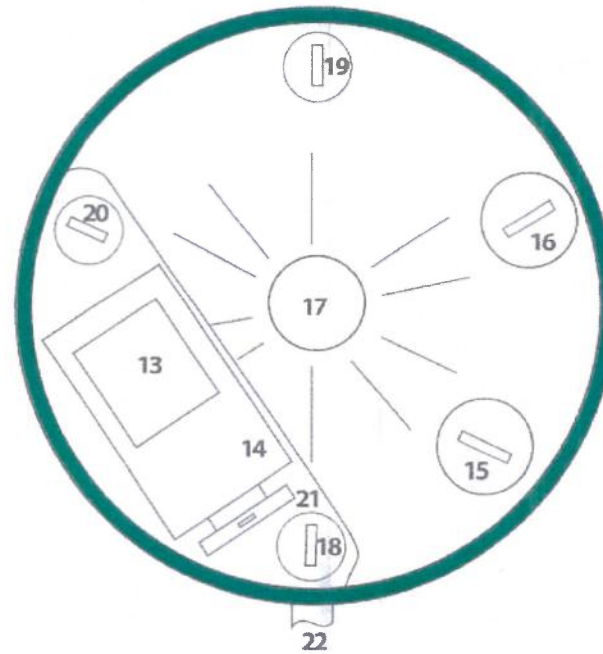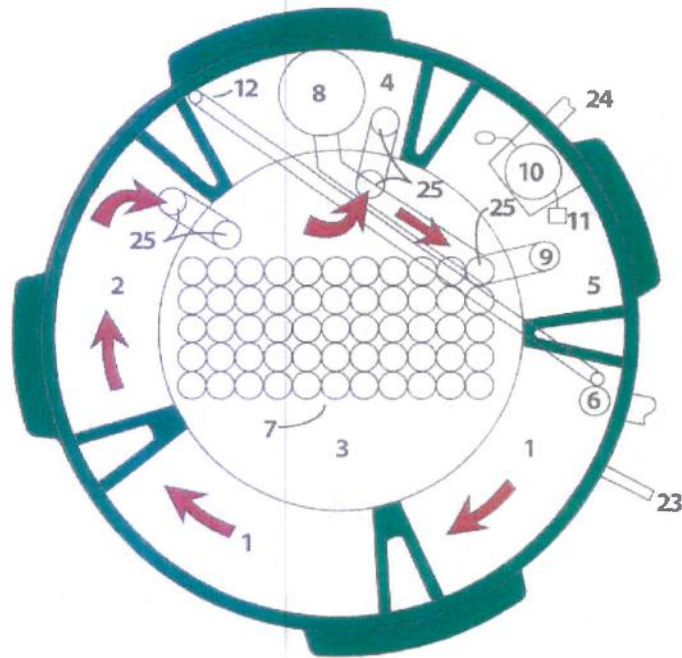

- 1 Primary
- 2 Secondary
- 3 Aeration
- 4 Clarifier
- 5 Irrigation
- 6 inlet
- 7 Biomass
- 8 TFG Filter
- 9 Chlorinator Tee
- 10 Irrigation Pump
- 11 High level Float
- 12 Sludge Return
- 13 80Lt Nitto Blower
- 14 Blower Box
- 15 Access Lid over Irrigation
- 16 Access Lid over Clarifier
- 17 Access Lid over Aeration
- 18 Access Lid over Inlet
- 19 Access Lid over Secondary
- 20 Access Lid over Primary 2
- 21 High Level Post Light and Switch
- 22 Inlet Socket
23. Electrical In
24. Irrigation Outlet
25. Transfer Tee's



TAYLEX INDUSTRIES 56 PRAIRIE RD ORMEAU 4221

Taylex Plastic ABS

DATE MAY 2012

DRAWN BY  
DARYL WILLISHER