



22,500lt TRAFFICABLE - RW22HD **INTERNAL** - Lifting Instructions

Mass Weight = 11.2 Tonne


Tank = 7.8 Tonne

Lid = 3.4 Tonne

Total Height = 2850mm


Total Width = 3450mm

LID SIDE VIEW

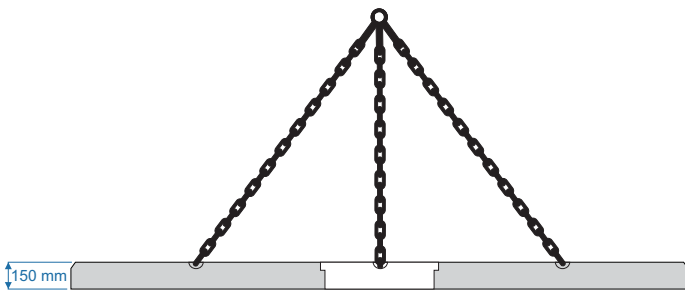


**LID SUPPLIED NOT SEALED TO TANK
FOR SEPARATE LIFTING**

LID TOP VIEW

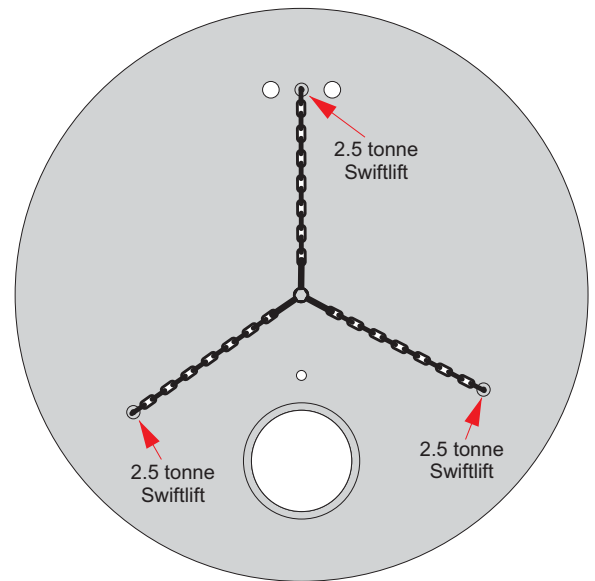


1. Always use certified lifting equipment
2. The Lid has 3 x 2.5 tonne swiftlifts for the separate lifting of the lid if required
3. The tank has 4 x 5 tonne swiftlifts on the internal of the tank for lifting
4. Always ensure the tank is empty before lifting

REACH OF CRANE/ CRANE TRUCK
To be determined by your crane/ crane truck operator.

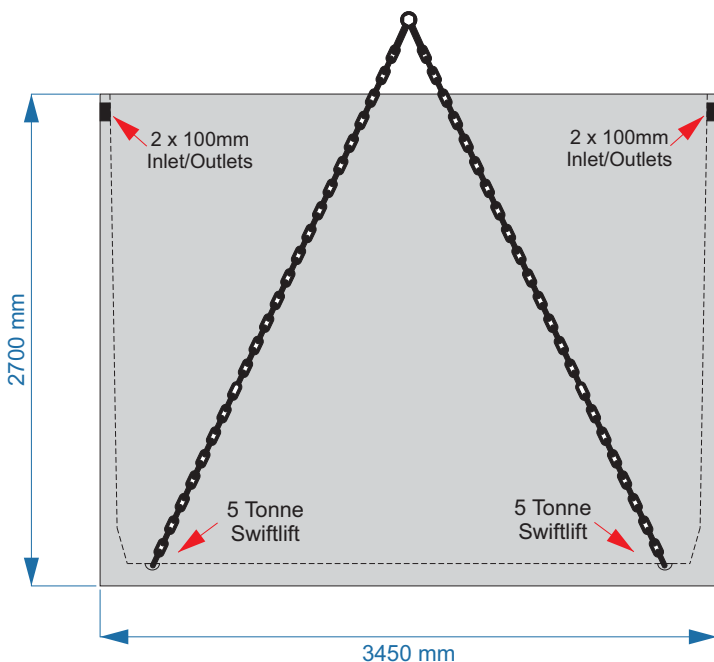

TANK SIDE VIEW

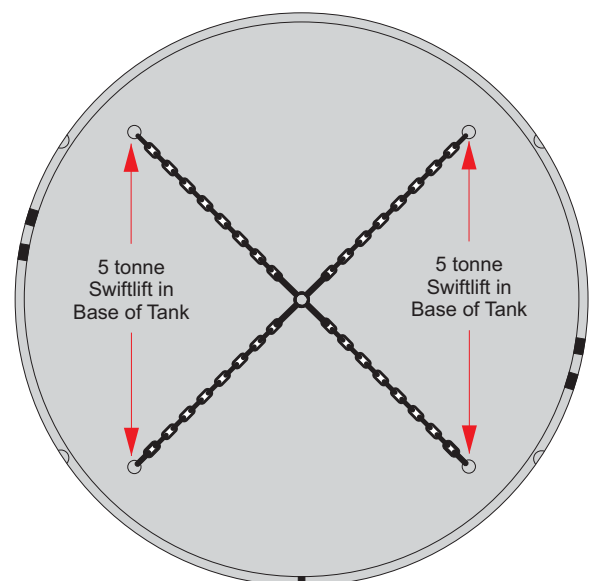

TANK TOP VIEW



22,500lt TRAFFICABLE - RW22HD **EXTERNAL** - Lifting Instructions

Mass Weight = 11.2 Tonne


Tank = 7.8 Tonne

Lid = 3.4 Tonne

Total Height = 2850mm


Total Width = 3450mm

LID SIDE VIEW

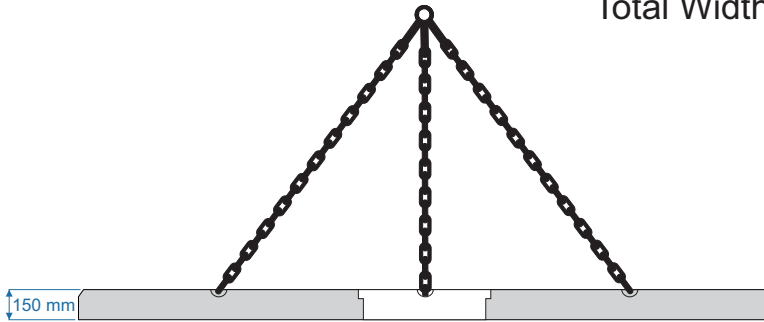

**LID SUPPLIED NOT SEALED TO TANK
FOR SEPARATE LIFTING**

LID TOP VIEW

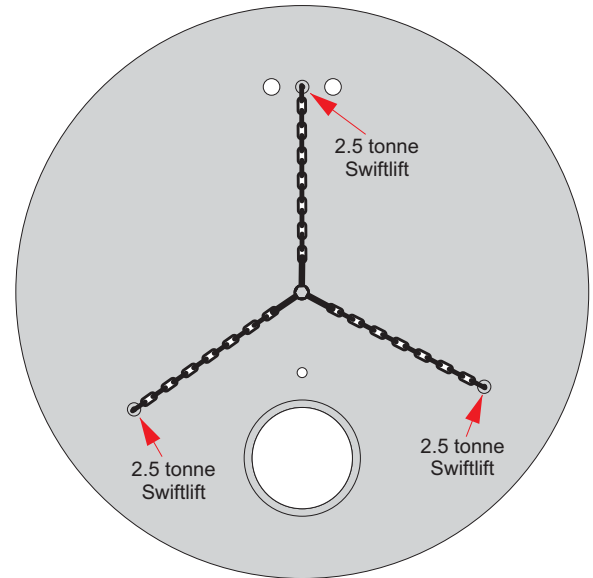


1. Always use certified lifting equipment
2. The Lid has 3 x 2.5 tonne swiftlifts for the separate lifting of the lid
3. The tank has 4 x 5 tonne swiftlifts on the external of the tank for lifting
4. Always ensure the tank is empty before lifting


REACH OF CRANE/ CRANE TRUCK

To be determined by your crane/ crane truck operator.

USE ONLY CERTIFIED LIFTING BARS

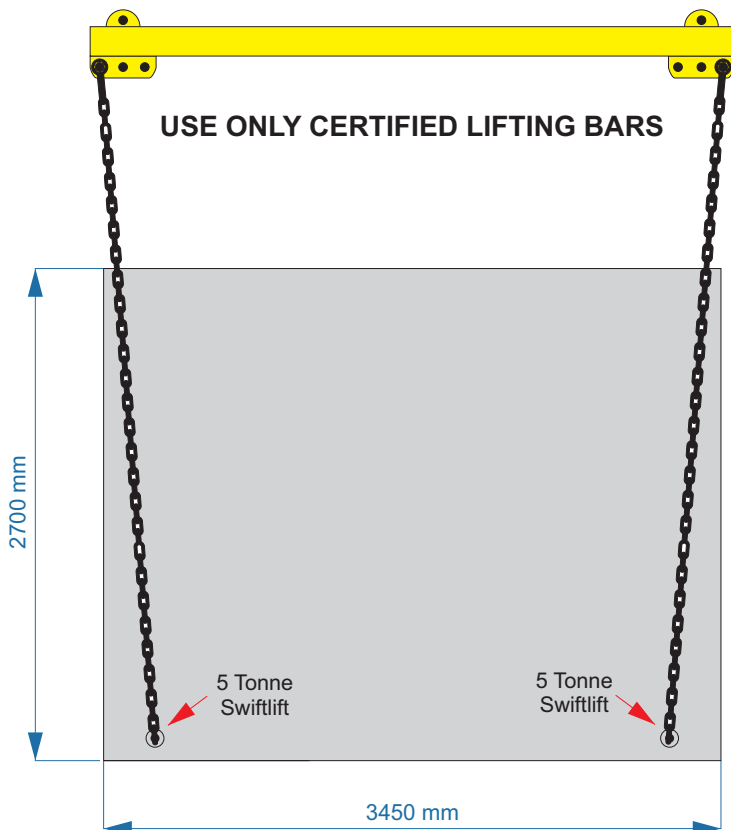

TANK SIDE VIEW

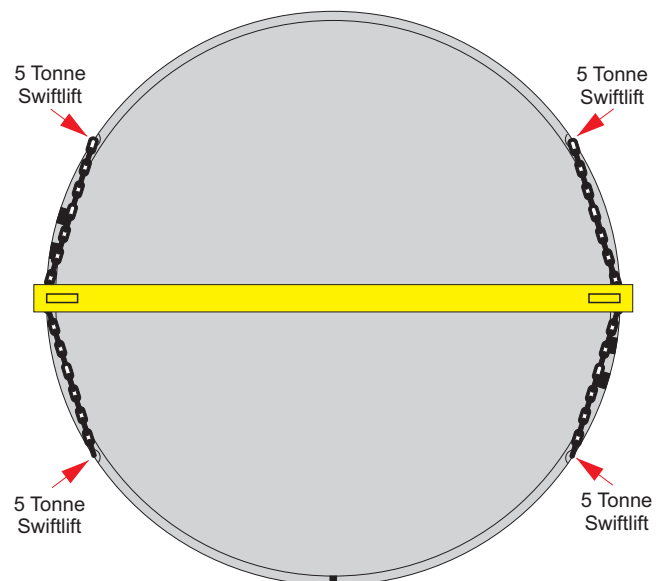

TANK TOP VIEW



22,500lt TRAFFICABLE - RW22HD Excavation Instructions

Mass Weight = 11.2 Tonne

Tank = 7.8 Tonne


Lid = 3.4 Tonne

Total Height = 2850mm

Total Width = 3450mm

Ground Level MUST Slope
Away From Access Lid

Light Traffic Only

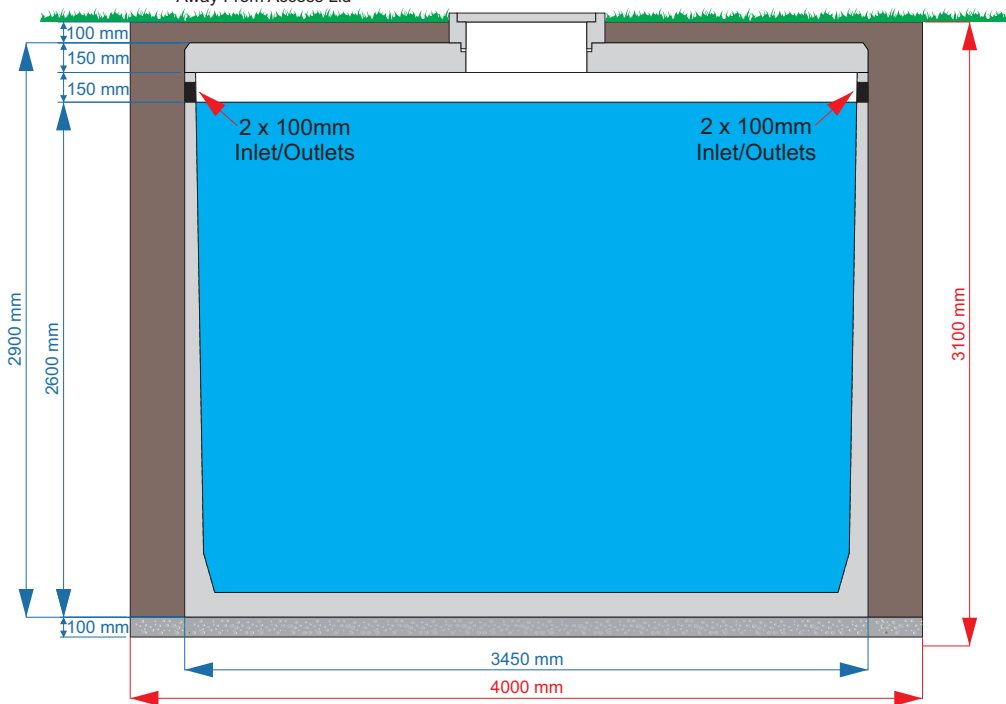

TANK SIDE VIEW


1. Dig hole 4000mm square & 3100mm Deep
2. Cover base of hole with 100mm of 5mm to 7mm drainage gravel
3. Ensure bottom of hole is level
4. Backfill with soil/sand. Avoid backfilling with large rocks
5. To prevent flotation while not connected to stormwater, the tank must be filled with 70% (15,500lt) of water immediately after installation

TRUCK ACCESS

Unloading of tank via the back of the truck
NOT SIDE. Ensure BACK of truck has clear
level 6m wide access to the edge of the hole.

REACH OF CRANE/ CRANE TRUCK

To be determined by your crane/ crane truck
operator.

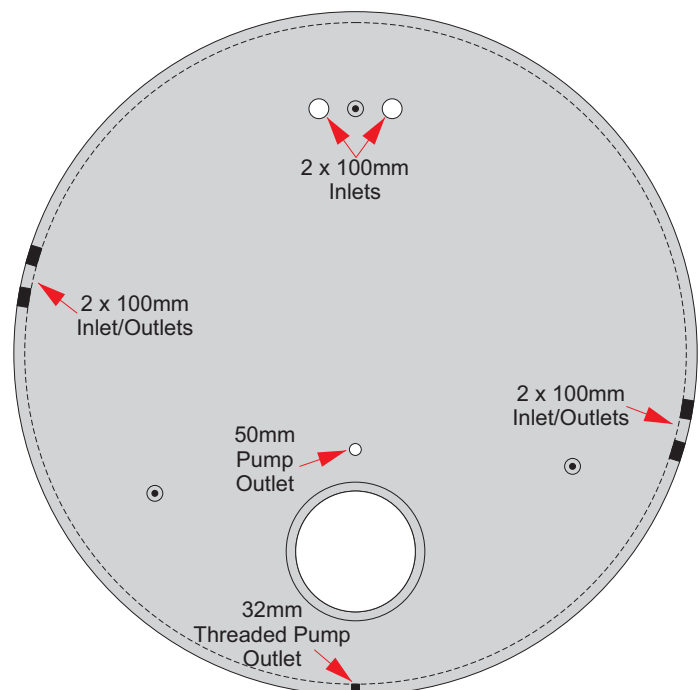

LID TOP VIEW